


VENTILATION DUCT HEATER SECTION 10 DESIGN / Mechanical

Figure 24

Valad Vent Duct Heaters are available in two basic designs:

Insert (Figure 23) and Frame (Figure 24).


**Figure 23
FRAME**

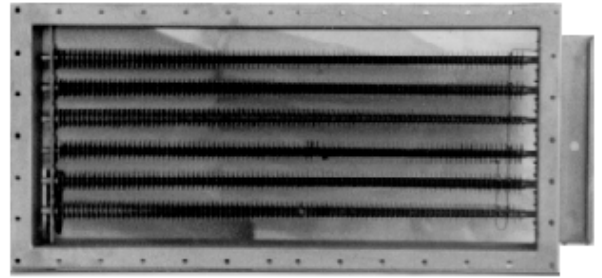

SIZING TERMINOLOGY:


Length - Width - Depth

Example: **VDH 12 X 8 -1**



Depth Chart

- 1 = 5.75
- 2 = 11.50
- 3 = 15.50

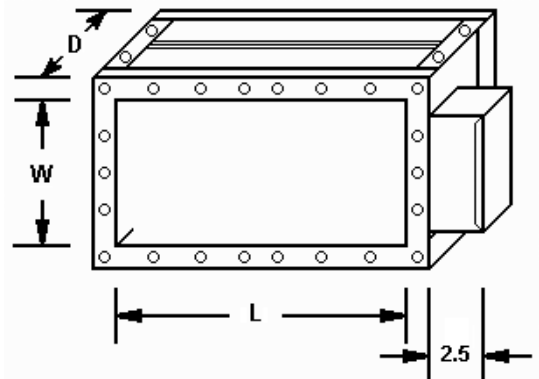

NOTE A:

Length dimension always on same plane as terminal box.

NOTE B:

Dimensions are always I.D. Dimensions add 3" to overall to get O.D. Dimensions.


MOUNTING:

FRAME TYPE:


13/32" Dia. holes are provided on a 3" center to center dimension. Balance of holes are reduced to 2" center to center (See Figure 26).

INSERT TYPE:

Mounting holes are provided on mounting plate. Customer uses plate for hole pattern (See Figure 27) to mount unit to duct. Hole patterns will vary according to size.

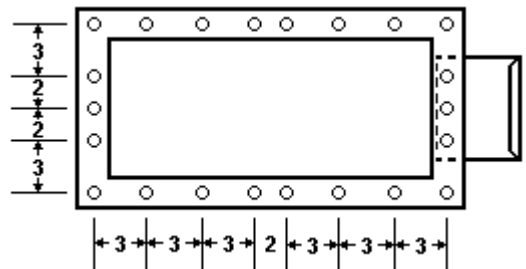

TYPICAL EXAMPLE -HOLES MAY VARY TO SUIT UNIT

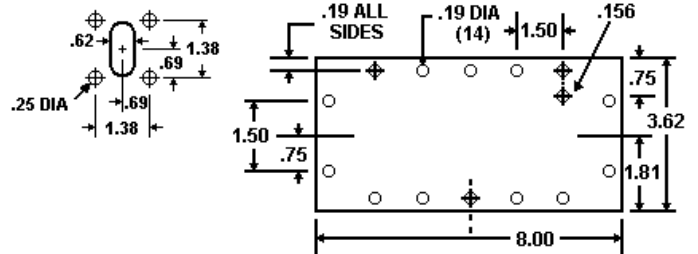

FRAME



ELECTRIC HEATING CORP.

160 WILDEY STREET
TARRYTOWN, N.Y. 10591 U.S.A.
(914) 631-4927 FAX: (914) 631-4395

VENTILATION DUCT HEATER SECTION 10

VELOCITY

Valad's Vent Duct Heaters are equipped with a manual or auto reset safety overload thermostat. A minimum velocity should be maintained to prevent thermostat tripping. (See sample one for calculation.)

Sample One: Duct heater size 18 length x 16 width
Wattage=10000W calculate wattage per square foot of duct area.
Re: 18"=1.5 ft 16"=1.3 ft

$$\frac{\text{Wattage}}{\text{Length} \times \text{Width(ft)}} = \frac{10000}{1.5 \times 1.3} = \frac{10000}{1.95} = 5128 \text{ W/sq. ft.}$$

Refer to Valad's Air Flow Chart A/minimum air required is 350 FPM. It is necessary to convert to CFM at this point:
350 x Total Duct Area (1.5 x 1.3) = (350 x 1.95) = 682.5 CFM

KILOWATT REQUIREMENTS

KW Requirements (See Chart B for KW load.)

Note: This chart is only a suggested KW load chart. Valad Electric will not be held liable for non-performance on values obtained from this chart.

PRESSURE DROP

Valad's heater design provides excellent resistance to air flow values. (See Chart C for values.)

CHART A - FIG. 28
AIR FLOW CHART


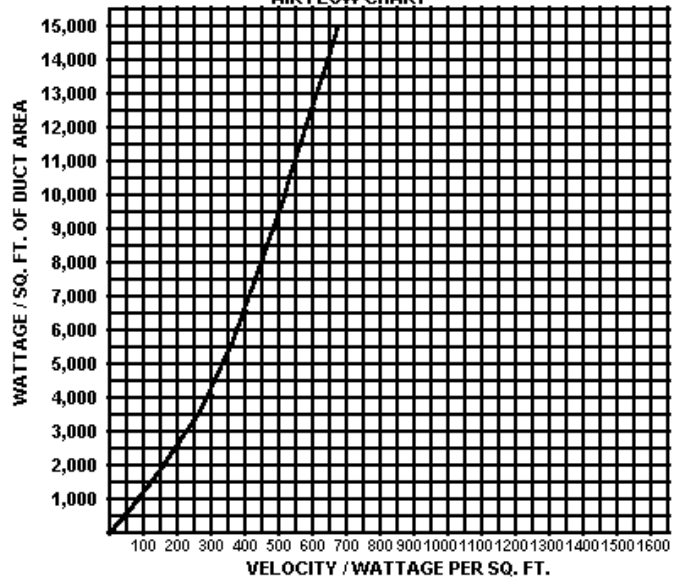


FIG. 28 CHART A

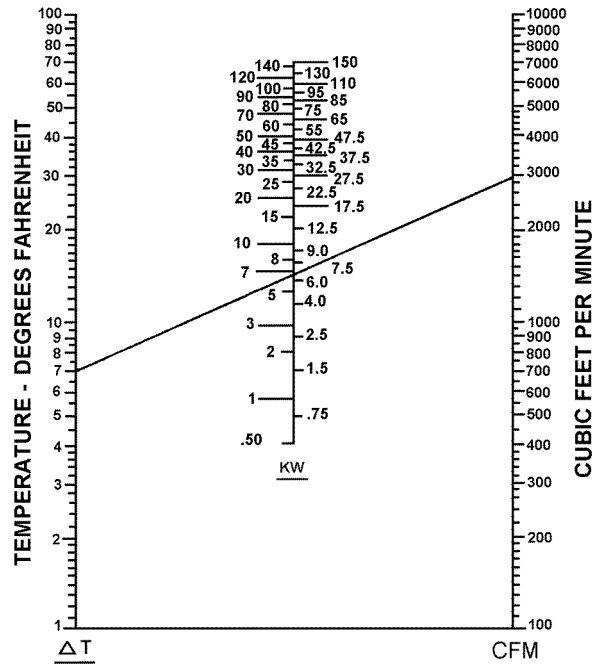

SAMPLE: To find the KW needed to raise 3000CFM through a temperature rise of 7 deg F on the Delta Scale and 3000 on the CFM Scale with a straight line. The intersect of this line with the KW Scale will indicate the required KW.

KILOWATTS REQUIRED
FIG.29 - CHART B

CHART C - Fig.30
Pressure Drop

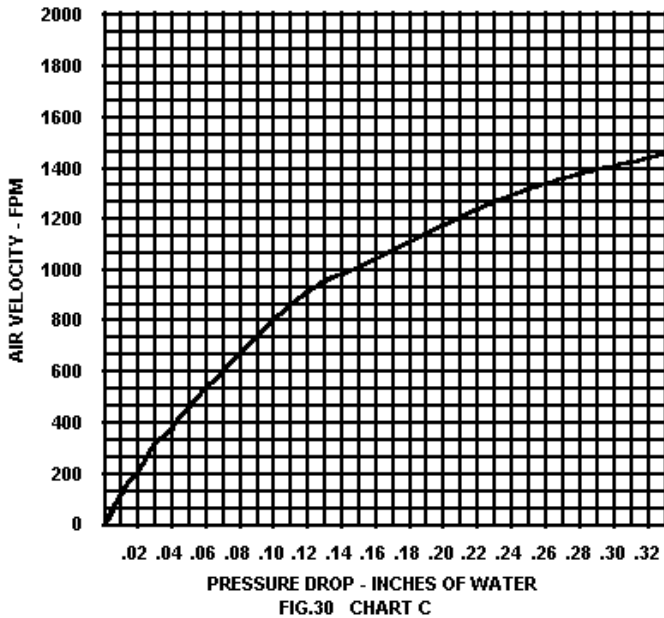


FIG.30 CHART C



ELECTRIC HEATING CORP.
160 WILDEY STREET
TARRYTOWN, N.Y. 10591 U.S.A.
(914) 631-4927 FAX: (914) 631-4395